AD Enclosure - Muon Extraction

Search and Secure Procedure

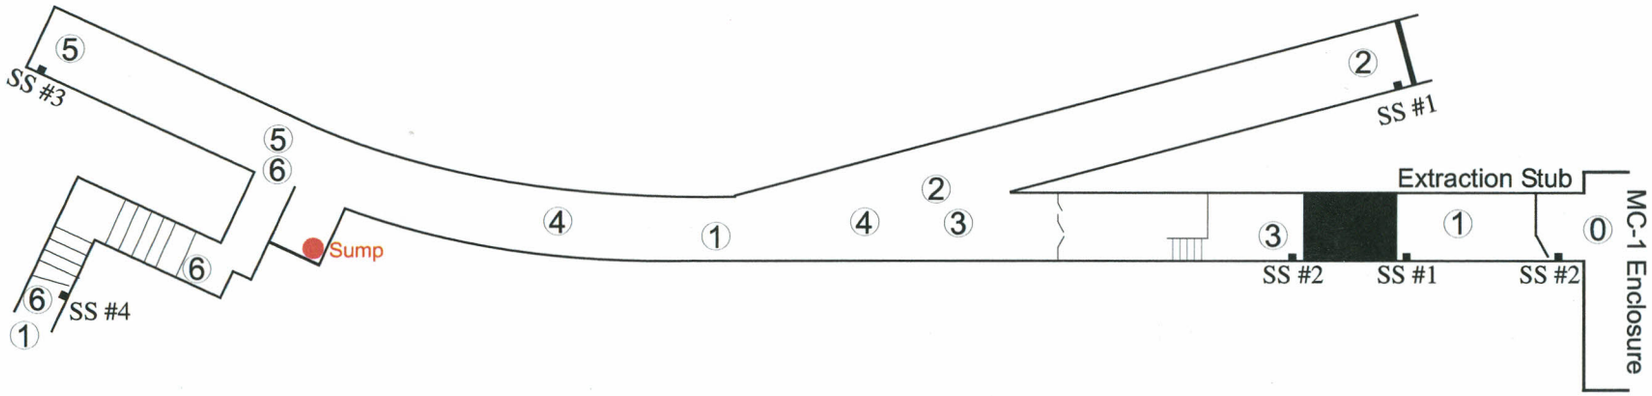

1) "**A**" and "**B**" enter the Extraction enclosure and proceed downstream
2) "**A**" holds while "**B**" sweeps the M4 line to reset Interlock Box #1.
3) "**B**" joins "**A**", then "**B**" sweeps the tunnel to reset Interlock Box #2 by the Extraction Stub wall.
4) "**B**" joins "**A**" and they sweep the tunnel upstream.
5) "**A**" holds while "**B**" sweeps the tunnel to reset Interlock Box #3.
6) "**B**" joins "**A**" and together they sweep the stairwell to exit and reset Interlock Box #4.

The Extraction Stub.

0) Enter from the MC-1 Enclosure, will need a MC-1 Key and an Extraction key.
1) "**A**" and "**B**" check the stub, reset Interlock Box #1, exit and reset Interlock Box #2.

Reviewed Area RSO	Date
N. Chelidze	2/17/2020
Approved AD/OPS Dept. Head	Date
Todd Sullivan	2/17/2020

CONTROLLED DOCUMENT
Users are responsible for ensuring they work to the latest approved revision. Printed or electronically transmitted copies are uncontrolled.