


C0 Service Building

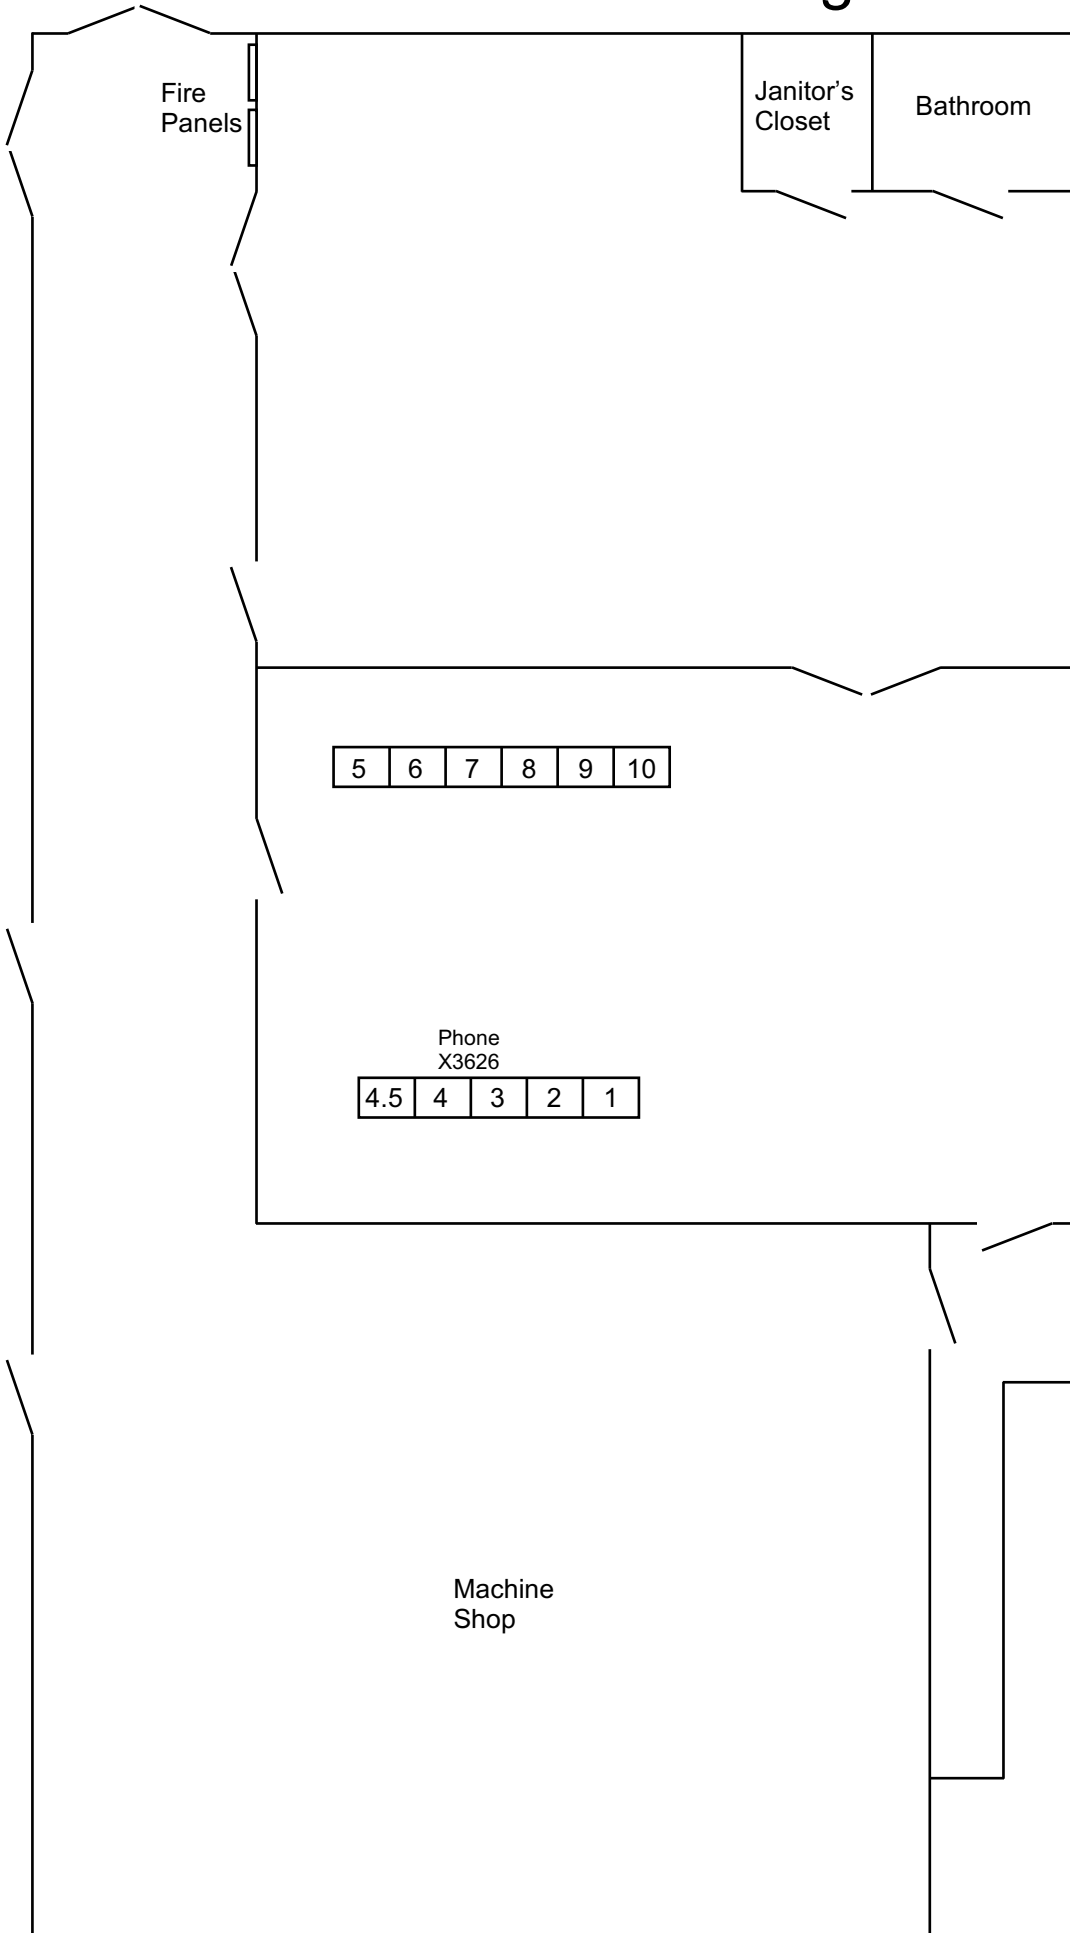

5
 C0 Emergency Exit ODH Chassis
 C0 Experimental Hall ODH Chassis
 Bertow P.S.
 Sorensen P.S.
 (2) Synclite Pulser

6
 CATV
 (2) National Instruments
 Sync Lite Computer

7
 Beam Valve for the Abort System
 CIA Crate
 Nude Ion Gauge Chassis
 IP01, 02, 03, 04 Doubler Pump P.S.
 IP05, 06, 07, 08 Doubler Pump P.S.
 IP09, 10 Doubler Pump P.S.
 C0 Quad Trim P.S>

8
 IGRCA Ion Gauge Controller
 VME ??
 Fluke P.S.
 Gas Modules
 SteoPak P.S.

9
 Crate \$2C
 MADC #59
 Networking

10
 Console CLX217
 VME
 8 Port Active Hub

1
 CATV
 (2) Video Modulators
 TAGI VME
 NIM Crate

2
 Beamline Beam Loss Monitor System
 (2) NIM Crates
 (3) Fluke P.S.

3
 Crate \$1C
 MADC #27
 Spectrographic Detector

4
 Crate #0C
 Repeater Crate
 NIM Crate
 Networking

4.5
 Empty