


AD Enclosure - M.T.A. - ODH Head Locations

Acnet Page
F81
MTA
<1>

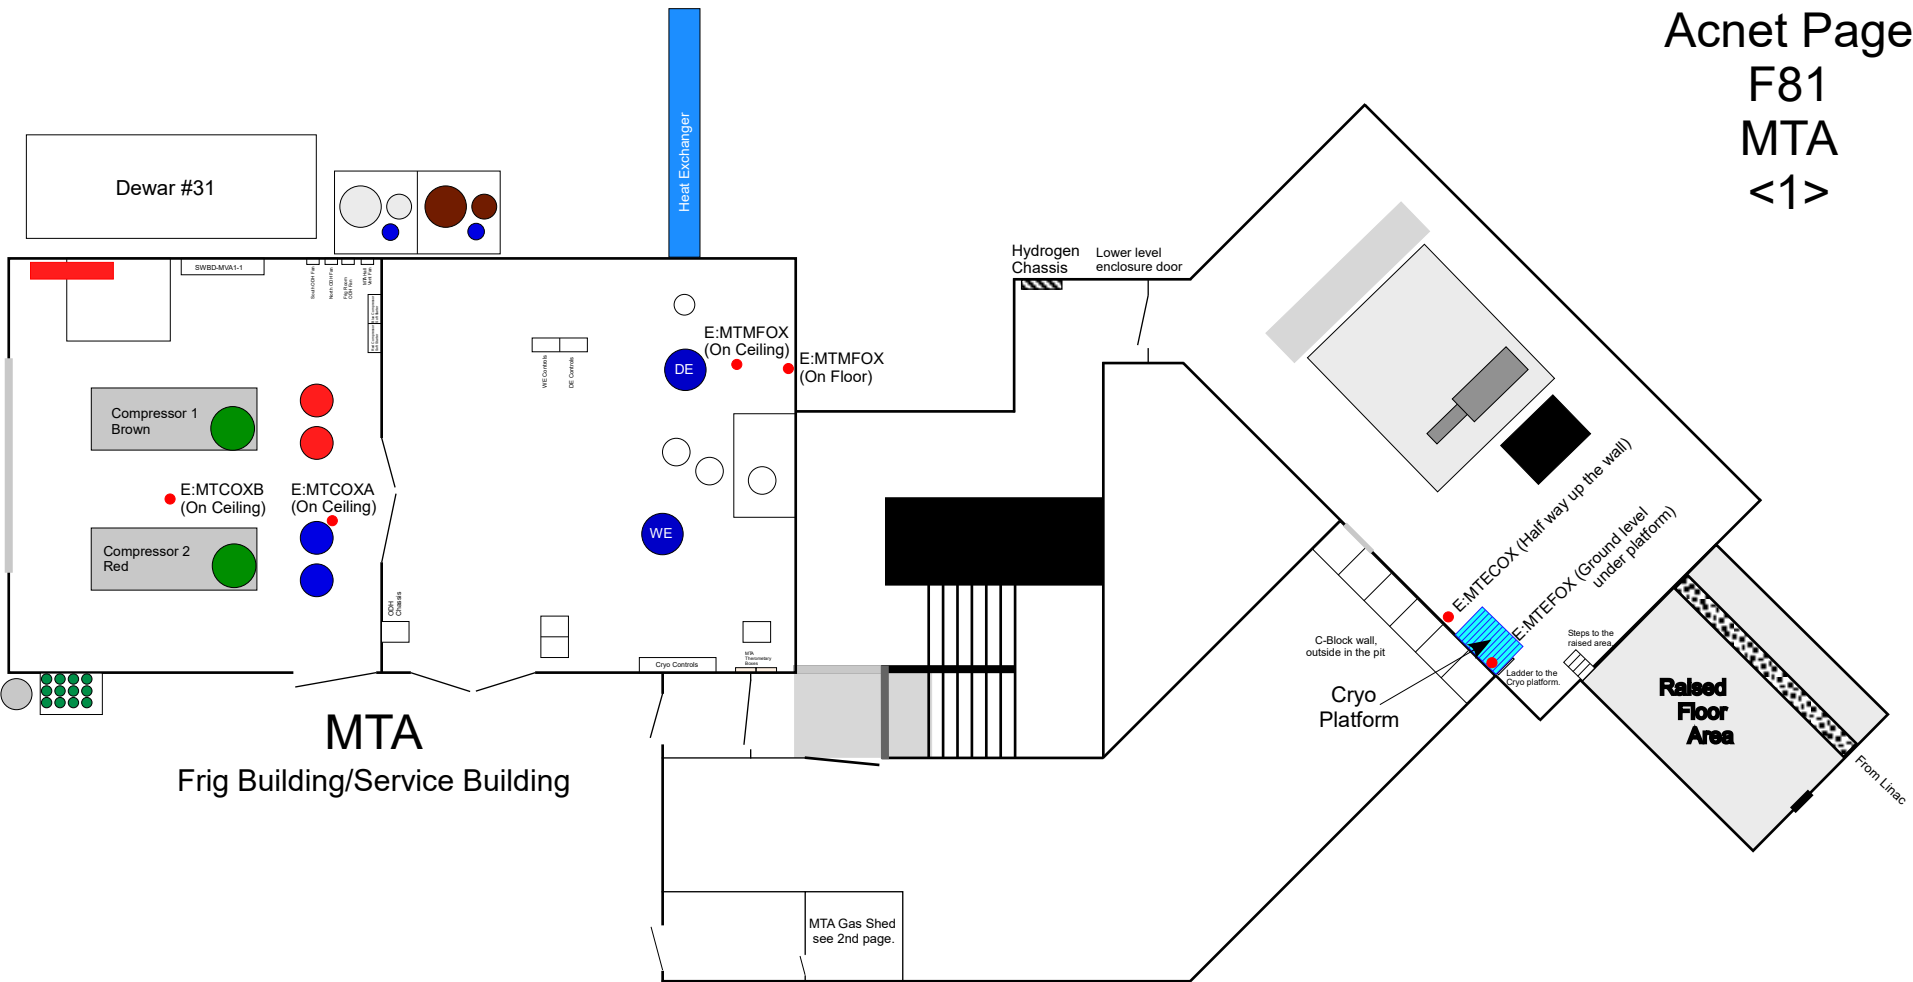

E:MTCOXA	MTA Compressor ODH A Mon	Acnet alarm only	Compressor Room
E:MTCOXB	MTA Compressor ODH B Mon	Acnet alarm only	Compressor Room
E:MTFCOX	MTA Frig Ceiling ODH Mon	Acnet alarm only	Frig Room
E:MTFFOX	MTA Frig Floor ODH Mon	Acnet alarm only	Frig Room
E:MTMCOX	MTA Manfld Room ODH Ceiling	Reports to FIRUS	Gas Shed
E:MTMFOX	MTA Manfld Room ODH Floor	Reports to FIRUS	Gas Shed
E:MTECOX	MTA Exp Hall ODH Ceiling	Reports to FIRUS	Pit
E:MTEFOX	MTA Exp Hall ODH Floor	Reports to FIRUS	Pit

Note: The ODH heads in the Gas Shed and the Pit are enclosed in special explosion proof boxes, not the normal "Red" boxes.

See next sheet for
Manifold Room (Gas Shed)

AD Enclosure - M.T.A. - ODH Head Locations

To enter the MTA Manifold Room (Gas Shed).
You will need the “MuCool Test Area Gas Manifold Area”
key located in the CC cabinet, key #C-7.

Acnet Page
F81
MTA
<1>

